


-15kV TOF: -9116 v
 -3.6kV MCP: -2578 v
 -2.4kV MCP: -1589 v
 Input Cur: 300 ma
 RPA max: 237 v
 Mirror max: 238 v

Tue Sep 26 12:19:31 2006

TIDE Direct Events

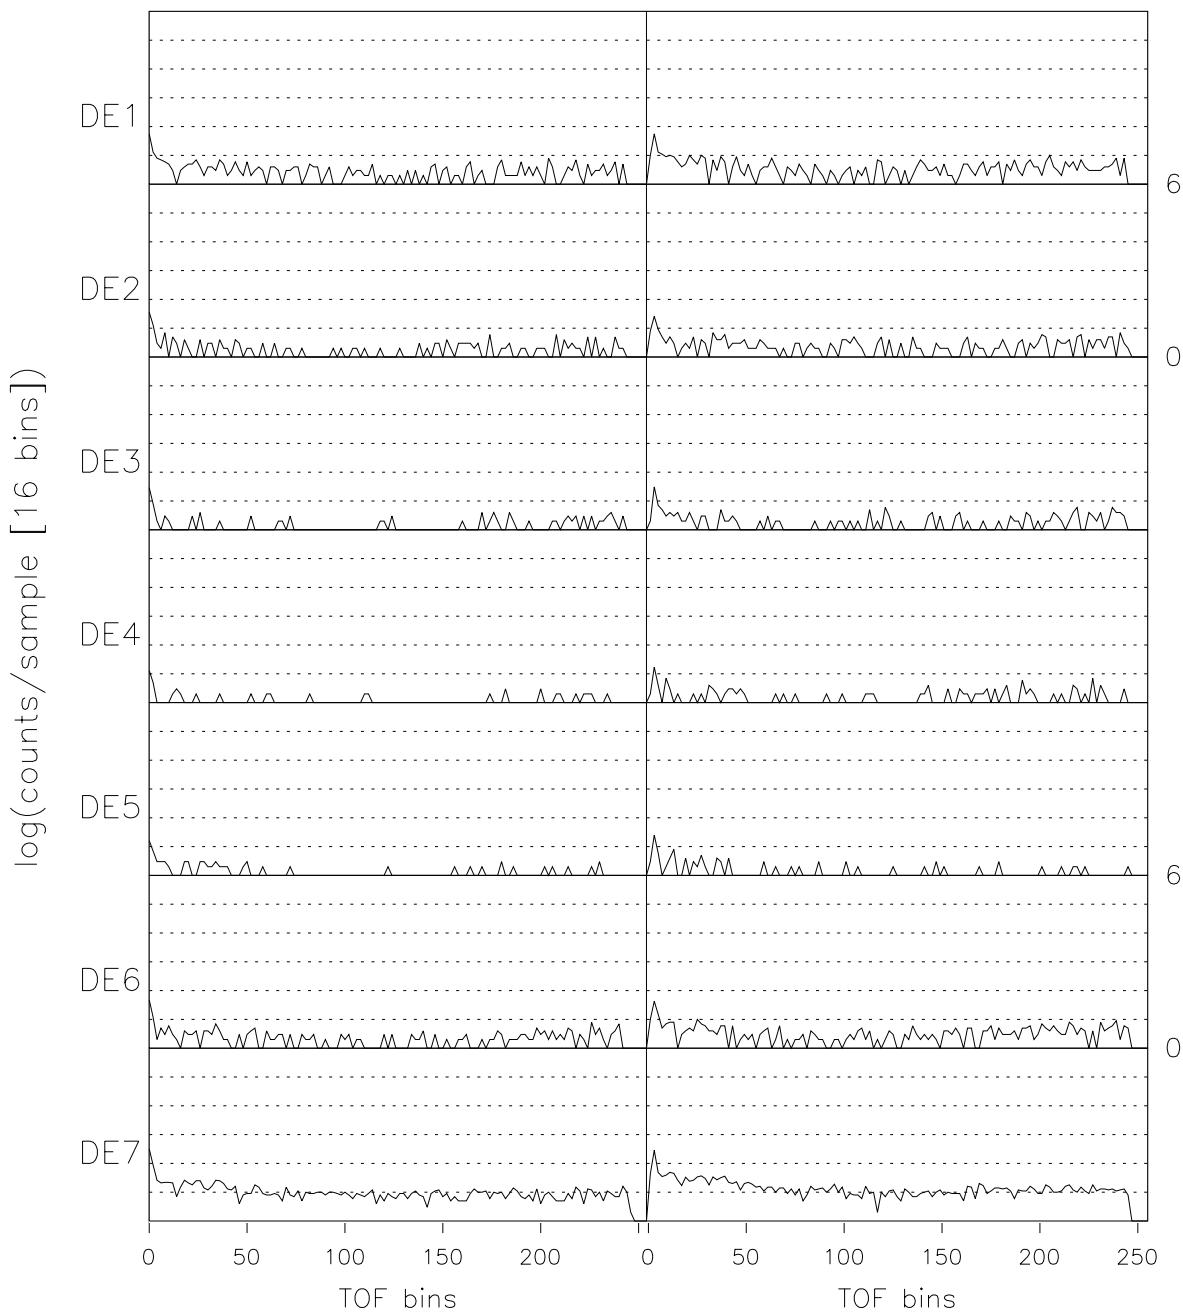

reported: 09-26-96 04:07:21 UT

reported: 09-26-96 04:10:34 UT

file: /export/data/tide/nrt/96092601.dat

-15kV TOF: -9116 v
-3.6kV MCP: -2389 v
-2.4kV MCP: -1589 v
Input Cur: 300 ma
RPA max: 237 v
Mirror max: 238 v